


### FIRE HYDRANT GUARD

### FIRE HYDRANT NOTES

1. USE HYDRANT GUARDS AT ALL FIRE HYDRANTS. (2 EACH HYDRANT)
2. 3" PIPE TO BE FILLED WITH CONCRETE AND PAINTED RED WITH REFLECTIVE YELLOW STRIPS (PER SPECIFICATIONS).
3. HYDRANT TO BE PAINTED YELLOW, PER SPECIFICATIONS.
4. CONTRACTOR TO FURNISH ONE FIRE HYDRANT WRENCH FOR THE PROJECT.

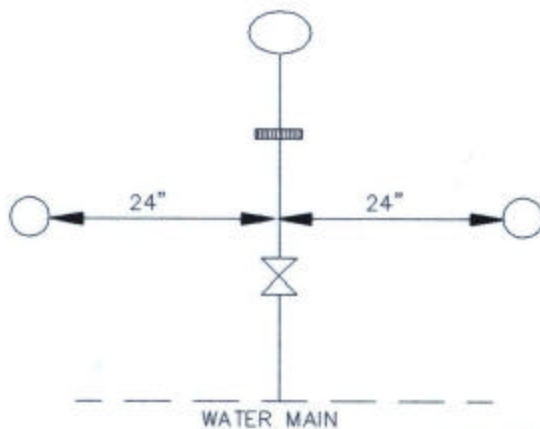

### BLOWOFF GUARD

### BLOWOFF NOTES

1. USE BLOWOFF GUARDS AT ALL BLOWOFFS. (2 EACH BLOWOFF)
2. 3" PIPE TO BE FILLED WITH CONC. AND PAINTED RED WITH YELLOW STRIPS.
3. BLOWOFF NOZZLE TO BE PAINTED YELLOW.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

DIRECTOR OF DEVELOPMENT SERVICES DATE

WATER / SEWER ENGINEER

DATE

STANDARD DETAIL  
FIRE HYDRANT GUARD  
AND  
BLOWOFF GUARD

REVISIONS:

W

5.06